

---

# **ECE 333 – GREEN ELECTRIC ENERGY**

## **9. Wind Data Analysis**

---

**George Gross**

**Department of Electrical and Computer Engineering**

**University of Illinois at Urbana–Champaign**

# WIND POWER MEASUREMENT AND DATA

---

- ❑ The collection of sufficient wind data to estimate the generation is an essential task in any wind project assessment at a specified site
- ❑ Various measurement devices – cup, sonic detection and ranging (*SODAR*), and light detection and ranging (*LIDAR*) anemometers – provide the ability to **measure wind speed, its direction and other relevant metrics of interest**

# WIND POWER MEASUREMENT AND DATA

---

- ❑ Wind is a highly uncertain phenomenon with high variability and wide changes over a brief period of time; as such, wind speed exhibits much volatility and randomness
- ❑ While wind speed is a continuous variable, wind speed data are collected on a sampled basis: values are measured on a periodic basis, such as hourly, every 10 minutes or every minute

# WIND POWER MEASUREMENT AND DATA

---

- ❑ Wind data for wind analysis requires the *collection around-the-clock of wind speed measurements at the altitude of interest* at a frequency commensurate with the nature and scope of the analysis
- ❑ The measurement scheme requires the specification of the smallest indecomposable unit of time:

# WIND POWER MEASUREMENT AND DATA

---

- for **planning evaluation and assessment**, the collection of data on an *hourly or half-hourly basis* is, typically, adequate
- for the analysis of **dynamic phenomena** such as stability, the collection has to be at a much finer resolution than hourly to capture the short time constants of such phenomena

# WIND POWER DATA

---

- ❑ The wind data collected may be used to approximate the probability distribution of wind at a specified site
- ❑ We make use of such approximations under the assumption that natural phenomena, such as wind, continue to behave in the future in a way similar to their past behavior


# WIND SPEED HISTOGRAM

---

- ❑ Suppose we wish to *probabilistically* characterize the wind speed at a given site and at its specified **altitude**: for that purpose, we collect hourly measurements over a long period of time and construct a *histogram* of the measured values
- ❑ We discretize the speed axis – we use the integer values of wind speed from 0 to 25 *m/s* – and we create 26 “**buckets**” of wind speed values

# WIND SPEED HISTOGRAM

- We place each hourly measured value in the appropriate “bucket” and we construct a *histogram* of the historical data such as shown below

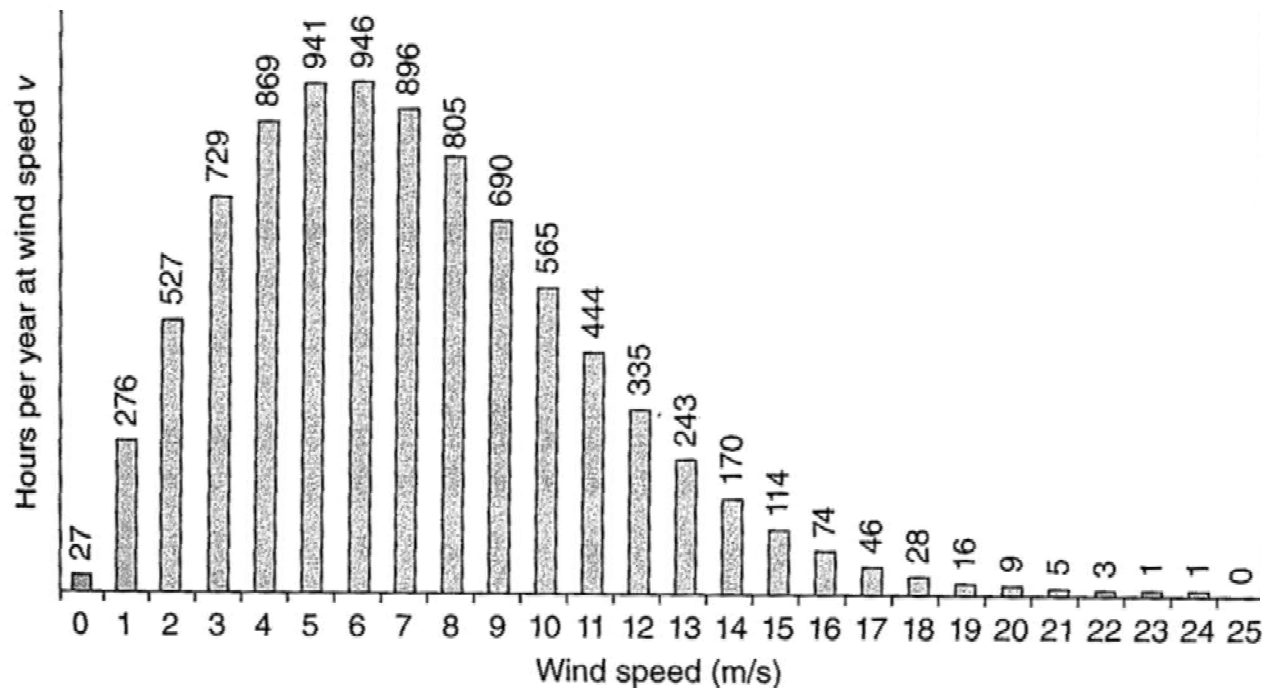

# INTERPRETATION OF THE HISTOGRAM

---

- ❑ We interpret the height of each bar at wind speed value  $v$  in the histogram as the **number of hours with wind speed value  $v$**
- ❑ We *normalize* the vertical axis values by dividing the number of hours of each bar by the total number of hours to obtain **the fraction of the total hours at a particular wind speed  $v$**
- ❑ Clearly, each bar has a value  $< 1$  and the sum of **all the bars must be exactly 1**

# INTERPRETATION OF THE HISTOGRAM

---

- ❑ In effect, we obtain a probability mass function of the wind speed
- ❑ To understand the probability interpretation, we view wind speed as a *random variable* (r.v.)  $V$  whose realizations are given by the histogram
- ❑ The *normalized histogram* provides the probability associated with each of the possible discrete-valued realizations

# INTERPRETATION OF HISTOGRAM

---

- The bar of the mass density function at the wind speed  $v$  provides

$$\mathbb{P}\{V_{\sim} = v\} = \textit{probability of wind speed at } v \textit{ m/s}$$

- We discretized the values of  $V_{\sim}$  by creating the 26 discrete buckets 0, 1, 2, ..., 25 but **in reality, wind speed does not take discrete values** since it is a continuously-valued variable
- Alternatively, we may consider to make use of an increasingly finer resolution grid so as to capture the fact that  $V_{\sim}$  is a **continuous** *r.v.*

# PROBABILITY DENSITY

---

- We associate with the continuous *r.v.*  $V \sim$  a *probability density function (p.d.f.)*  $f_V(v)$  with the following properties

○  $f_V(v) \geq 0 \quad \forall v \geq 0$

○  $\int_0^{\infty} f_V(v) dv = 1$

# PROBABILITY DENSITY

---

○ for an infinitesimally small  $\delta > 0$


$$\mathbb{P}\{v < V_{\sim} \leq v + \delta\} \approx f_{V_{\sim}}(v) \delta$$

$$\mathbb{P}\{v_1 < V_{\sim} \leq v_2\} = \int_{v_1}^{v_2} f_{V_{\sim}}(v) dv$$

□ The *p.d.f.*  $f_{V_{\sim}}(\bullet)$  provides a **complete analytic**

**characterization of the continuous *r.v.*  $V_{\sim}$**

# PROBABILITY DENSITY

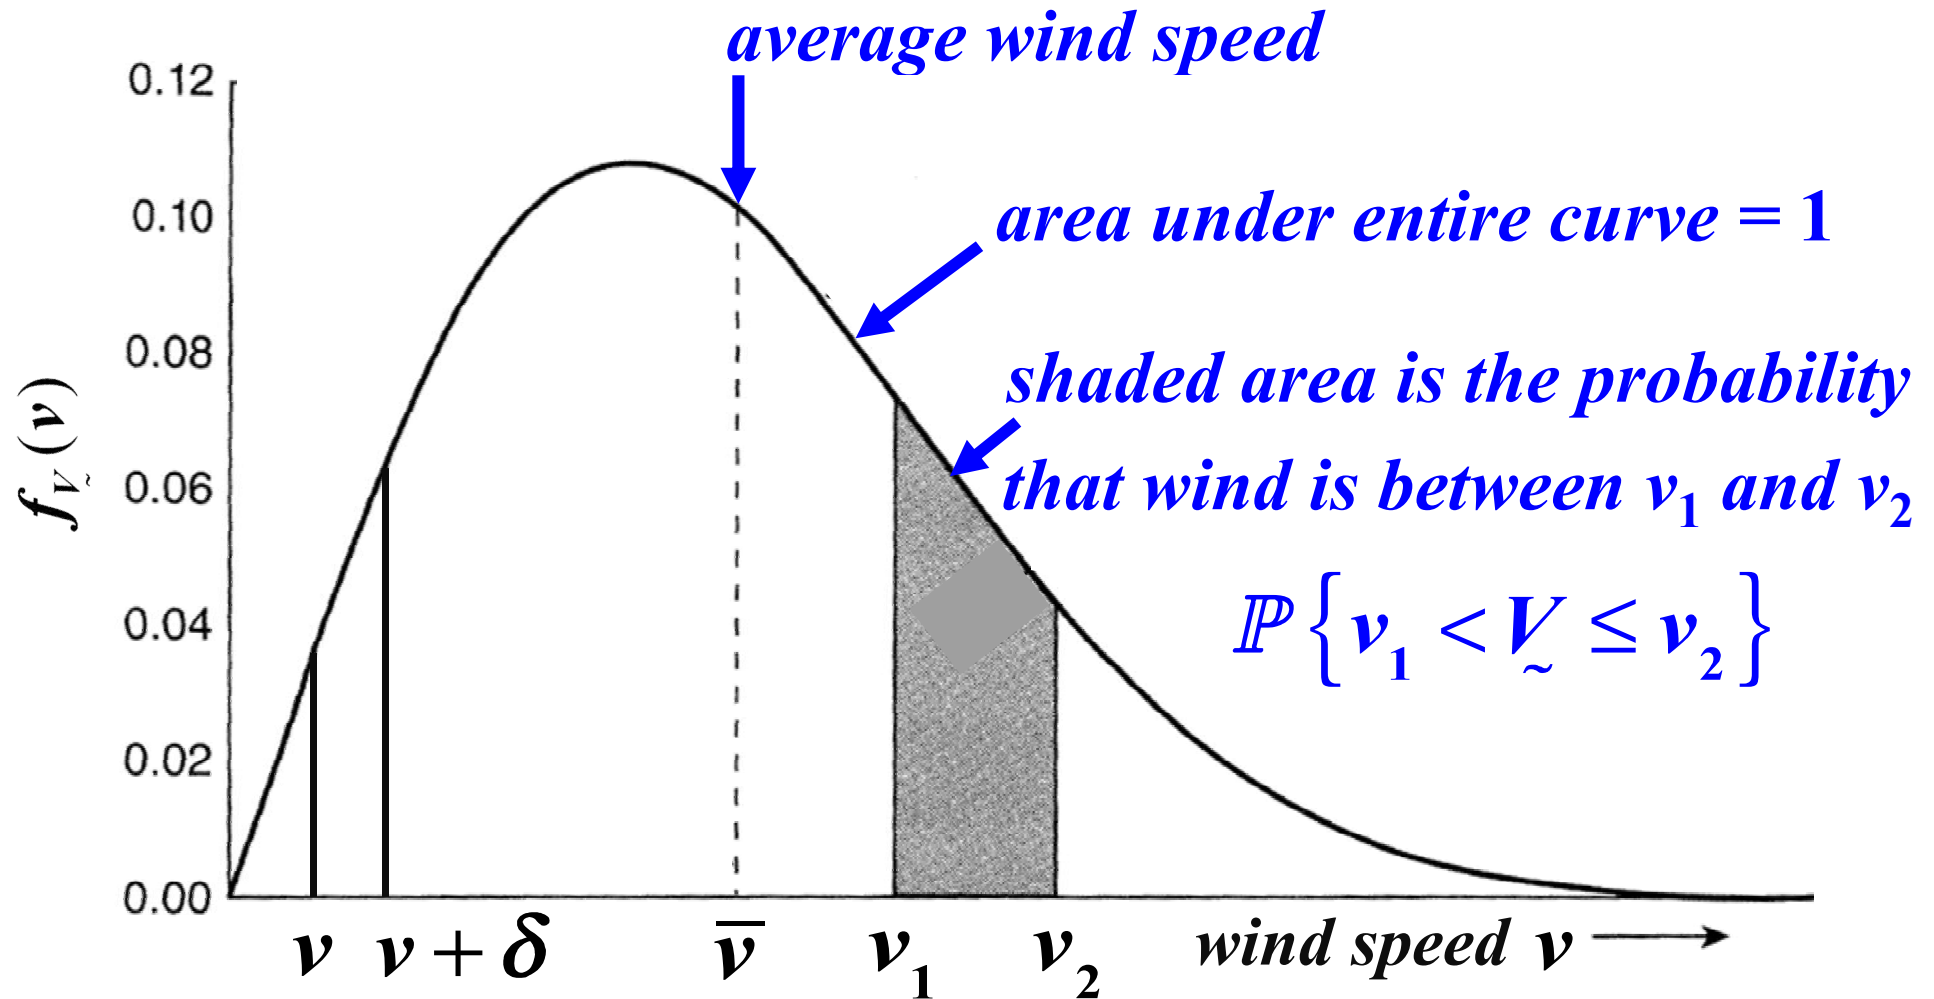

# PROBABILITY DENSITY

---

□ We may readily compute any function of  $V_{\sim}$ ,

○ average wind speed:

$$\bar{v} = \int_0^{\infty} v f_{V_{\sim}}(v) dv$$

○ wind speed cubed:

$$E\{V_{\sim}^3\} = \int_0^{\infty} v^3 f_{V_{\sim}}(v) dv$$

# PROBABILITY DENSITY

---

○ number of annual hours  $v_1 < \tilde{V} \leq v_2$ : we define

the indicator function  $i(x)$  with the property

$$i(x) = \begin{cases} 1 & v_1 < x \leq v_2 \\ 0 & \textit{otherwise} \end{cases}$$

and compute

$$8,760 \int_0^{\infty} i(v) f_{\tilde{V}}(v) dv = 8,760 \int_{v_1}^{v_2} (1) f_{\tilde{V}}(v) dv$$

# WEIBULL DISTRIBUTION


---

- The general Weibull distribution given by

$$f(v) = \frac{k}{c} \left( \frac{v}{c} \right)^{k-1} e^{-\left( \frac{v}{c} \right)^k} \quad \begin{array}{l} k = \textit{shape parameter} \\ c = \textit{scale parameter} \end{array}$$

is often used to approximate the *p.d.f.* of  $V_{\sim}$

# WEIBULL DISTRIBUTION

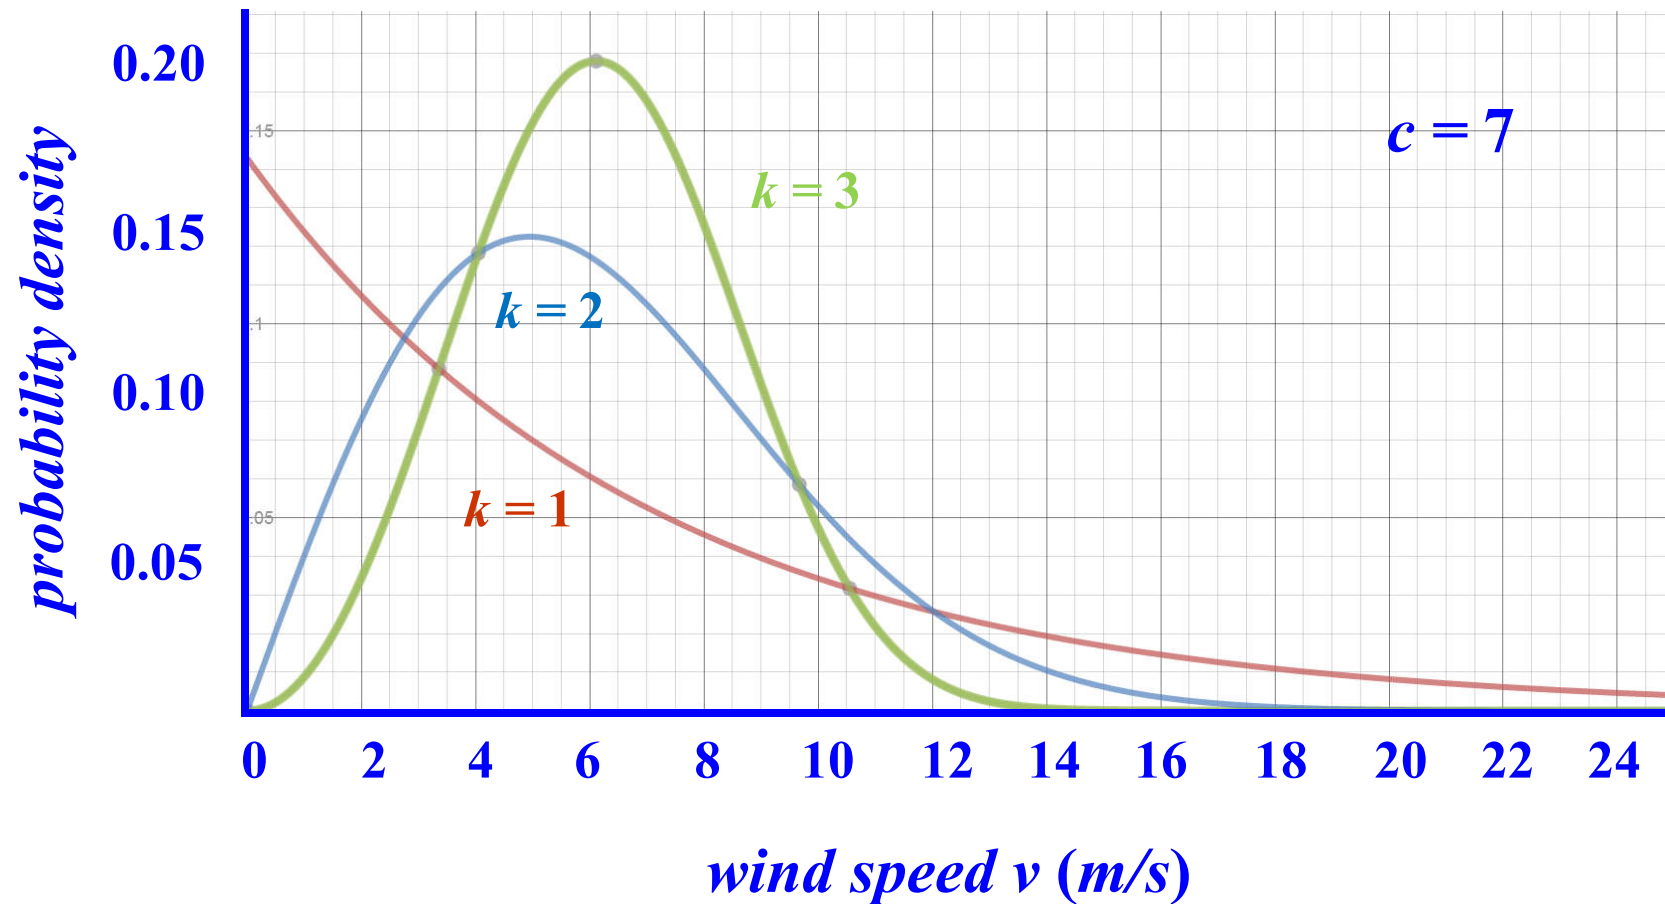

# WEIBULL DISTRIBUTION

---

□ For  $k = 2$ , the *Weibull distribution* is called the

*Rayleigh p.d.f.*

$$f(v) = \frac{2v}{c^2} e^{-\left(\frac{v}{c}\right)^2} \quad \text{Rayleigh p.d.f.}$$

□ The Rayleigh distribution is **very widely used** in

**the analytic characterization of wind**

# WEIBULL DISTRIBUTION

---

□ Note that for  $V_{\sim} \sim \text{Rayleigh}$ , the mean is given by


$$\bar{v} = \int_0^{\infty} v f_{V_{\sim}} dv = 2 \int_0^{\infty} \left(\frac{v}{c}\right)^2 e^{-\left(\frac{v}{c}\right)^2} dv = \frac{\sqrt{\pi}}{2} c$$

and so we may restate the expression for  $f_{V_{\sim}}(\cdot)$  as

$$f_{V_{\sim}}(v) = \frac{v \pi}{2 (\bar{v})^2} e^{-\frac{\pi}{4} \left(\frac{v}{\bar{v}}\right)^2}$$

# WEIBULL DISTRIBUTION

- As  $\bar{v}$  increases,  $f_v(\cdot)$  becomes flatter and shifts to the right, as shown below

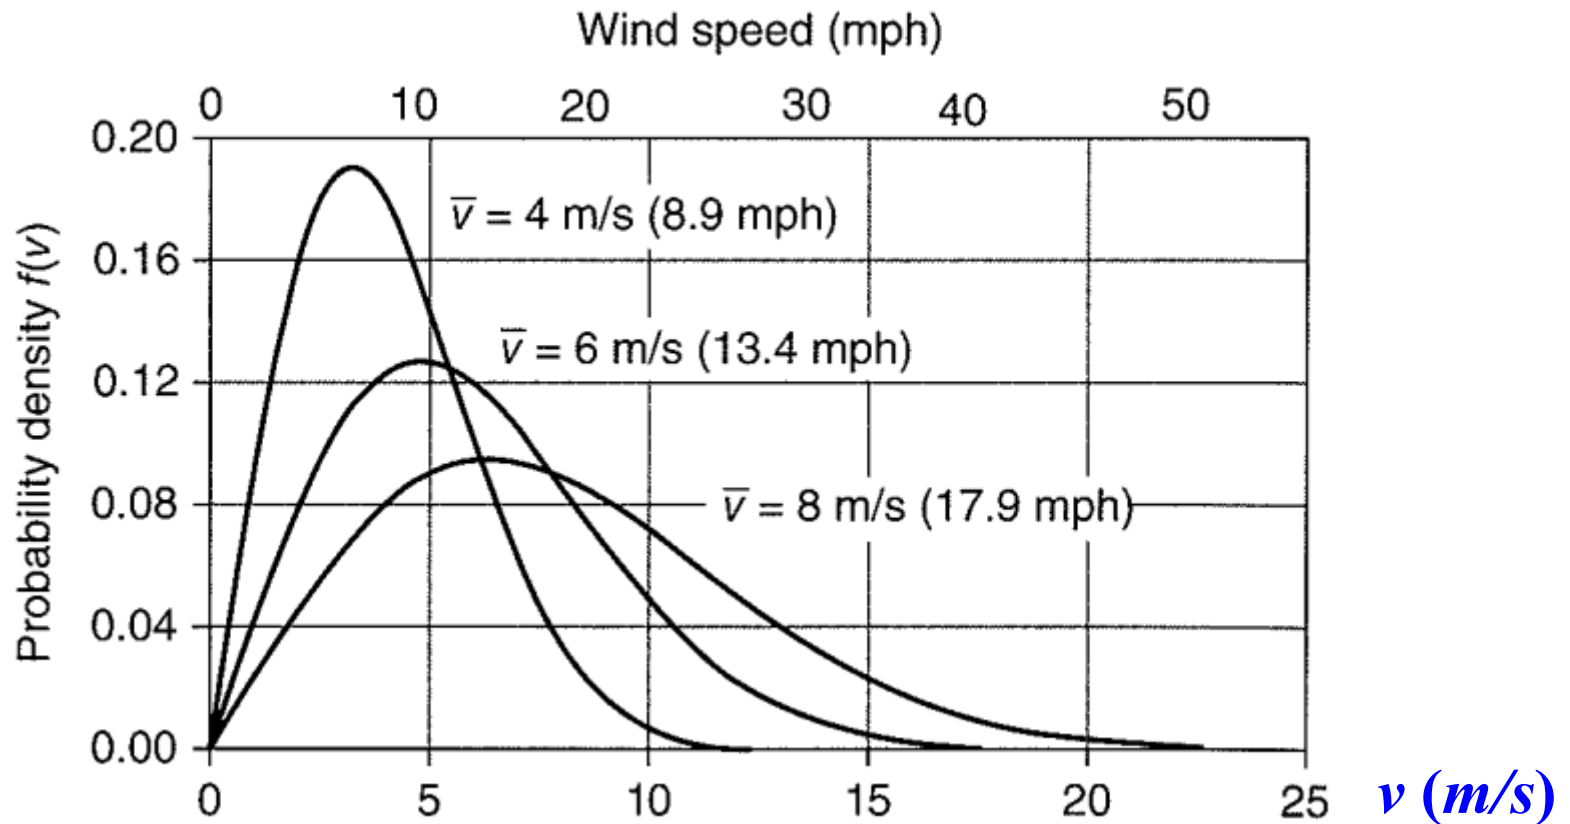

# RAYLEIGH-DISTRIBUTION-BASED CALCULATIONS

---

- The wide use of Rayleigh distribution is due to the good approximations it provides for the average wind speed  $\bar{v}$
- We have that

$$\bar{v} = \frac{\sqrt{\pi}}{2} c$$

and so we evaluate

$$E\left(\tilde{V}^3\right) = \int_0^{\infty} v^3 \frac{\pi v}{2(\bar{v})^2} e^{-\left[\frac{\pi}{4}\left(\frac{v}{\bar{v}}\right)^2\right]} dv = \frac{6}{\pi} (\bar{v})^3 \approx 1.91 (\bar{v})^3$$

# RAYLEIGH-DISTRIBUTION-BASED CALCULATIONS

---

- A Rayleigh wind is the term we use to indicate a wind whose probability distribution is specified by the Rayleigh distribution
- We note that a Rayleigh distribution is completely specified once the average wind speed  $\bar{v}$  is known as the parameters of this particular Weibull distribution for the  $k = 2$  case are all known

# RAYLEIGH-DISTRIBUTION-BASED CALCULATIONS

---

- This closed-form solution for Rayleigh-based wind distribution allows us to calculate the average power in wind

$$\bar{p} = \frac{1}{2} \rho a (\bar{v})^3 (1.91)$$

and therefore, it becomes very clear that we

**cannot** simply use  $(\bar{v})^3$  directly to evaluate  $\bar{p}$  but

need to also **explicitly include** the  $\frac{6}{\pi} \approx 1.91$  factor

# WIND POWER OUTPUT DISTRIBUTION

---

- Wind power output is a function of the *r.v.*  $V_{\sim}$  and therefore wind power output is itself a *r.v.*, i.e.,

$$P_{\sim} = g(V_{\sim}) = \frac{1}{2} \rho a (V_{\sim})^3$$

- For wind *r.v.*  $V_{\sim} \sim Weibull$  *p.d.f.* with

$$f_{V_{\sim}}(\mathbf{v}) = \frac{k}{c} \left( \frac{\mathbf{v}}{c} \right)^{k-1} e^{-\left( \frac{\mathbf{v}}{c} \right)^k}$$

the *cumulative distribution function* is given by

$$F_{V_{\sim}}(\mathbf{v}) = \mathbb{P}\{V_{\sim} \leq \mathbf{v}\} = \int_0^{\mathbf{v}} \frac{k}{c} \left( \frac{\xi}{c} \right)^{k-1} e^{-\left( \frac{\xi}{c} \right)^k} d\xi$$

# WIND POWER OUTPUT DISTRIBUTION

---

□ Since, we can introduce a change of variables, we set

$$u = \left( \frac{\xi}{c} \right)^k \quad \text{and} \quad du = \frac{k}{c} \left( \frac{\xi}{c} \right)^{k-1} d\xi$$

so that

$$F_{\tilde{V}}(v) = \int_0^{\left(\frac{v}{c}\right)^k} e^{-u} du = 1 - e^{-\left(\frac{v}{c}\right)^k}$$

# WIND POWER OUTPUT DISTRIBUTION

---

□ For the special case of *Rayleigh p.d.f.*


$$F_{V_{\sim}}(\nu) \Big|_{Rayleigh} = 1 - e^{-\left[\frac{\pi}{4}\left(\frac{\nu}{\bar{\nu}}\right)^2\right]}$$

□ Note that the probability that *Rayleigh* wind

exceeds the value  $\nu$  is

$$\mathbb{P}\{V_{\sim} > \nu\} = 1 - F_{V_{\sim}}(\nu) \Big|_{Rayleigh} = e^{-\left[\frac{\pi}{4}\left(\frac{\nu}{\bar{\nu}}\right)^2\right]}$$

# ALTAMONT PASS, CA: HISTORICAL DATA *p.d.f.* vs. RAYLEIGH *p.d.f.*

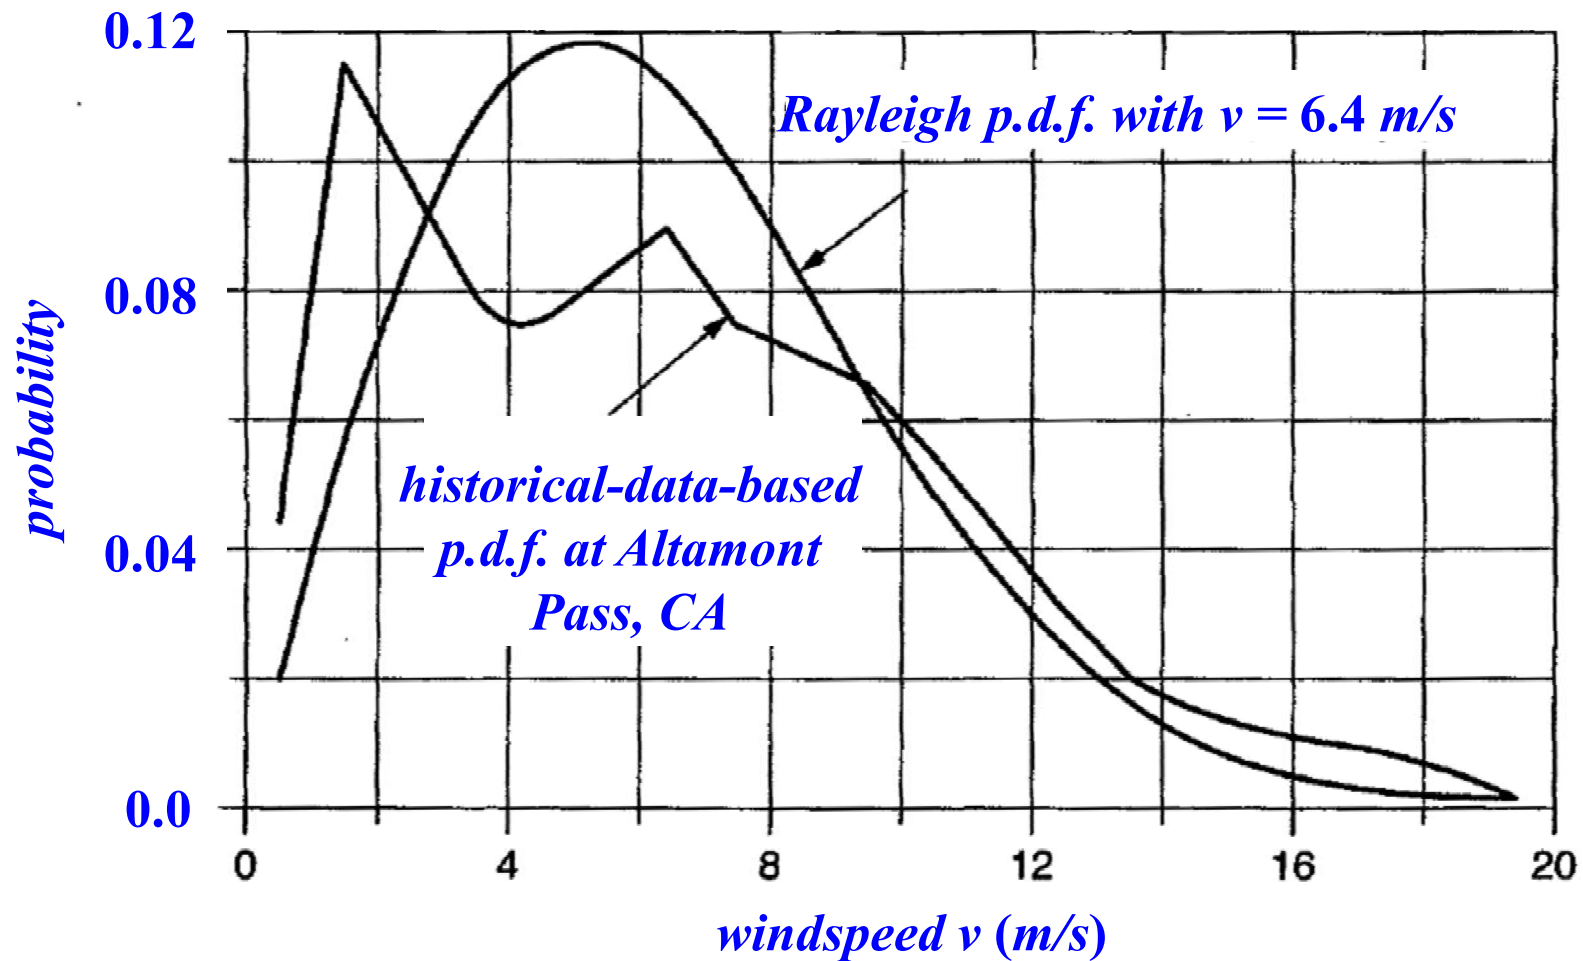

# EXAMPLE: AVERAGE POWER IN THE WIND

---

- ❑ Based on data from a standard anemometer at a height of  $10\text{ m}$ ,  $\bar{v}(10) = 6\text{ m/s}$
- ❑ The plan is to erect a  $50\text{ m}$  tower for the nacelle placement and we need to estimate the average power under the assumptions
  - Hellman exponent  $\alpha = \frac{1}{7}$
  - $\rho = 1.225 \frac{\text{kg}}{\text{m}^3}$
  - Rayleigh distribution may be used

# EXAMPLE: AVERAGE POWER IN THE WIND

---

- The first step is to compute  $\bar{v}(50)$

$$\bar{v}(50) = \bar{v}(10) \left( \frac{50}{10} \right)^{\frac{1}{7}} = 7.55 \frac{m}{s}$$

- Since Rayleigh distribution holds

$$\frac{\bar{p}(50)}{a} = \frac{6}{\pi} \cdot \frac{1}{2} \rho [\bar{v}(50)]^3 = 1.91 \cdot \frac{1}{2} \cdot 1.225 \cdot (7.55)^3 = 504 \frac{W}{m^2}$$

- Sensitivity case for an 80-m tower:


$$\frac{\frac{\bar{p}(80)}{a}}{\frac{\bar{p}(50)}{a}} = \left( \frac{80}{50} \right)^{\frac{3}{7}} \quad \frac{\bar{p}(80)}{a} = 504 \left( \frac{80}{50} \right)^{\frac{3}{7}} = 616 \frac{W}{m^2}$$

# THE IDEALIZED WIND TURBINE POWER CURVE

---

- ❑ Each turbine manufacturer provides a plot of the electrical power output of the entire system – the blades, the gearbox, the generator, and the other components – as a function of wind speed
- ❑ Such a plot is called an **idealized wind turbine power curve**
- ❑ The typical shape of an idealized wind turbine power curve is given below

# THE IDEALIZED WIND TURBINE POWER CURVE

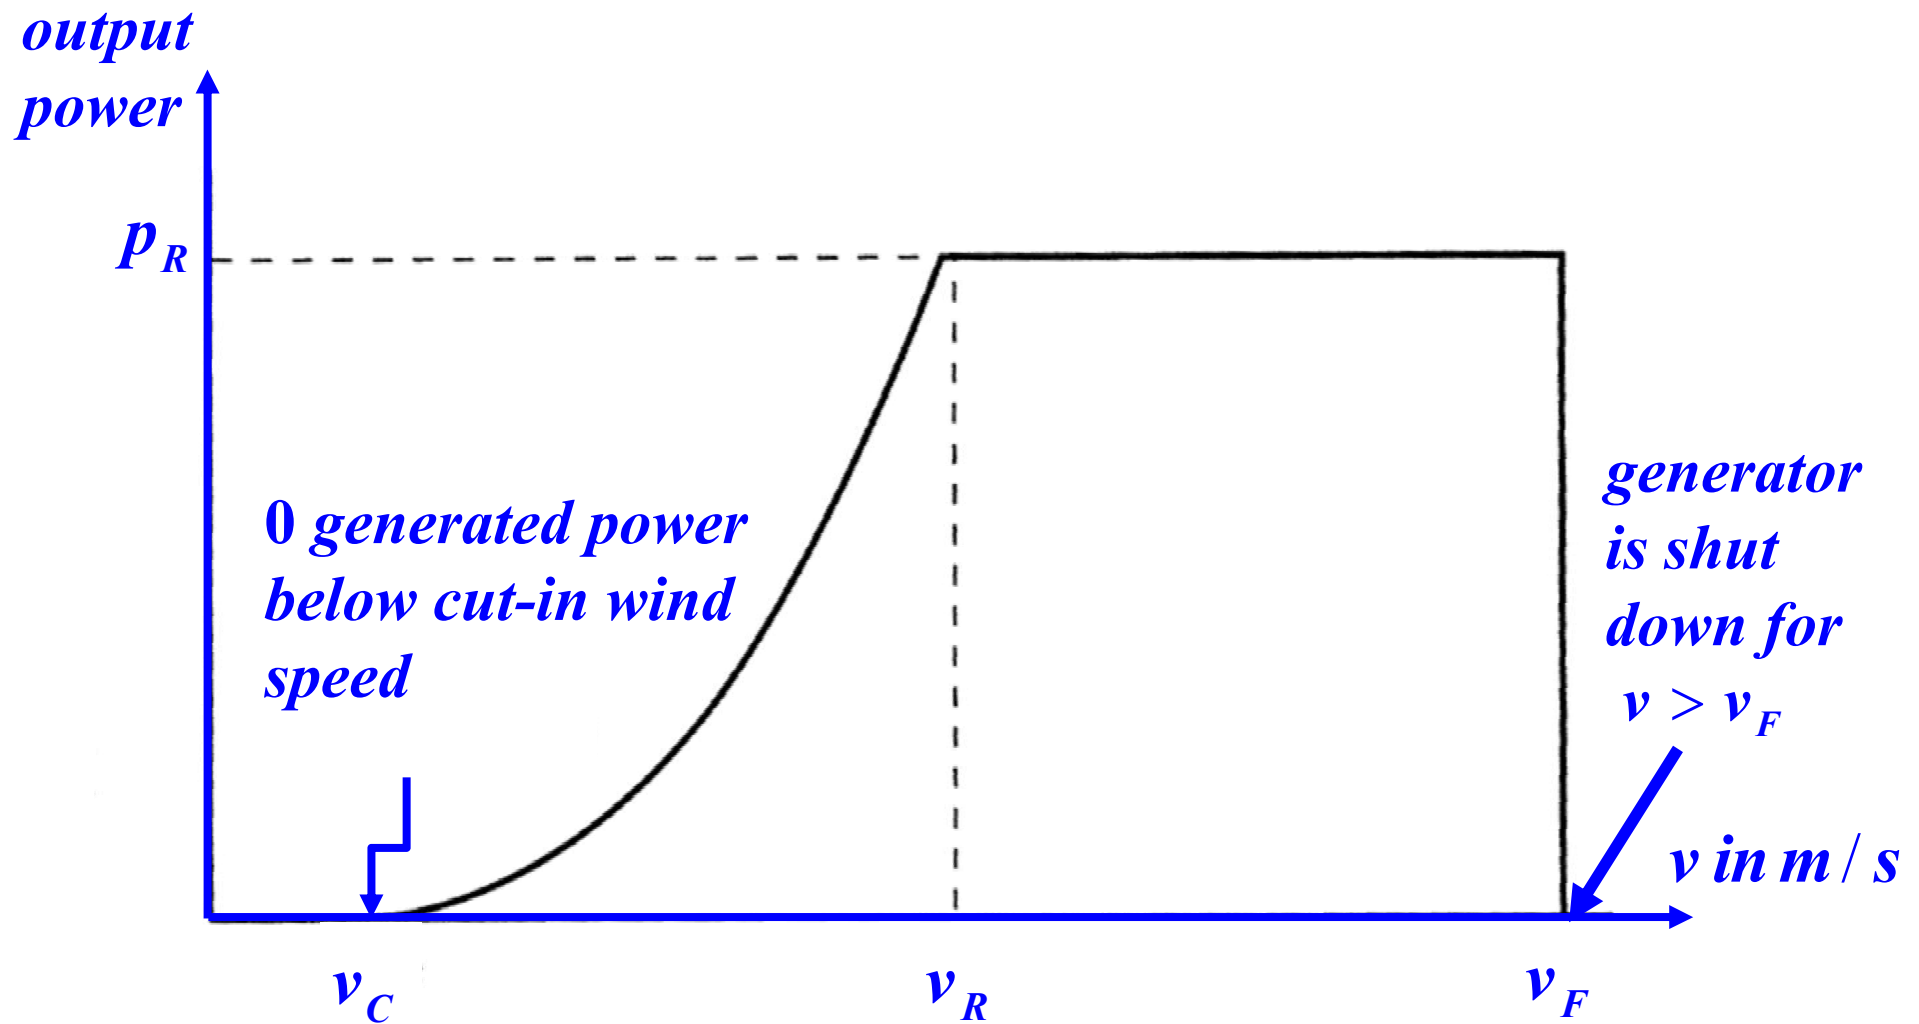

# THE IDEALIZED WIND TURBINE POWER CURVE

---

- At low speeds, wind has **insufficient energy to overcome friction in the turbine drive train, even if the generator rotor is spinning: below the *cut-in wind speed*  $v_C$ , the power output is 0**
- **Above  $v_C$ , the power output is a cubic function of  $v$ ; at the rated wind speed  $v_R$ , the generator delivers its rated power  $P_R$**

# THE IDEALIZED WIND TURBINE POWER CURVE

---

- At  $v > v_R$ , controls are deployed to shed some of the wind so as not to exceed  $P_R$
- When wind speed reaches the *cut-out value*  $v_F$  – sometimes called by the sailing term **furling wind speed** – the machine is shut down and the mechanical brakes lock down the rotor shaft above  $v_F$  wind speeds and the output power is 0

# IMPACTS OF DESIGN PARAMETERS

---

□ We can assess the impact of two key design parameters:

○ the diameter  $d$  of the blade rotor


○ the rated generator capacity

on the power output determined via the idealized power curve

□ The power output  $p \propto d^2$  since  $d^2$  determines the area swept by the blades


# IMPACTS OF DESIGN PARAMETERS

- For a generator with rated power  $P_R$ , an increase in  $d$  produces a shift in the power curve to the left and the output  $P_R$  is reached at a lower speed

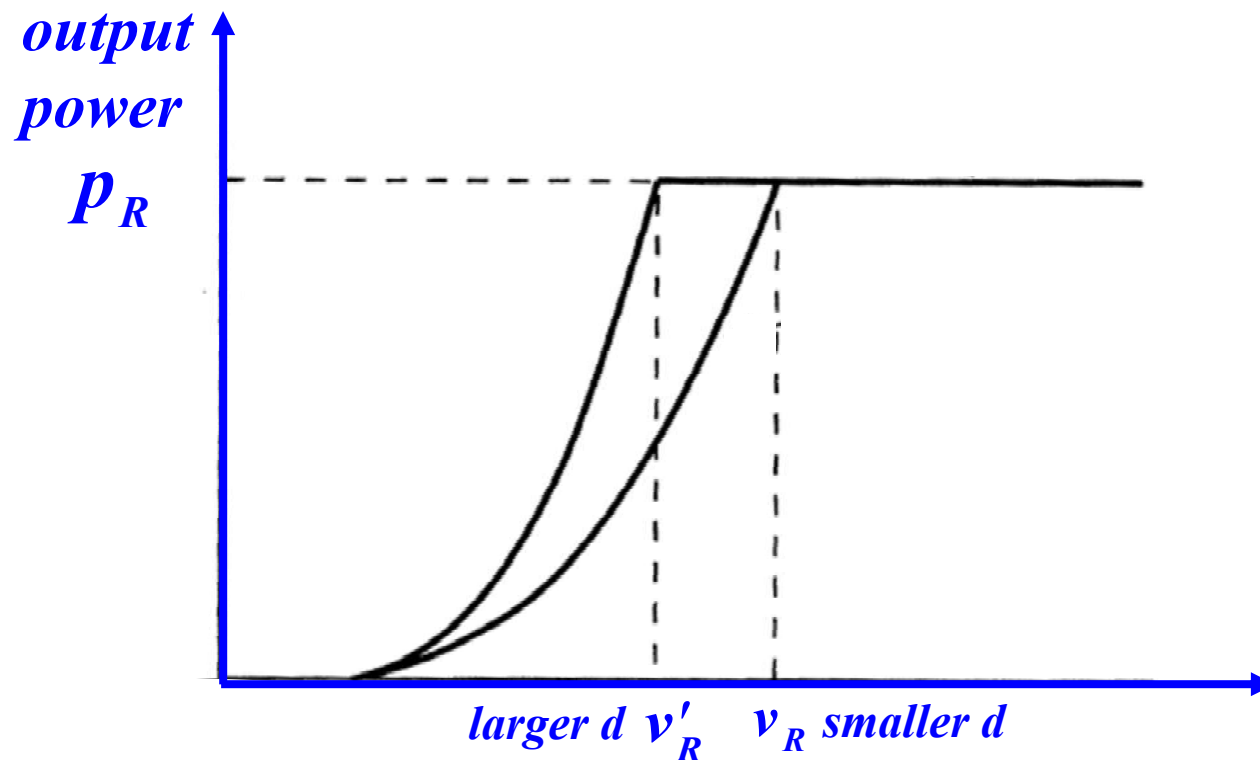


# IMPACTS OF DESIGN PARAMETERS

- For a **fixed rotor diameter  $d$** , an increase in the generator rated capacity may be determined by the continuation of the power curve up to the higher  $v_R$  corresponding to the higher  $p_R$

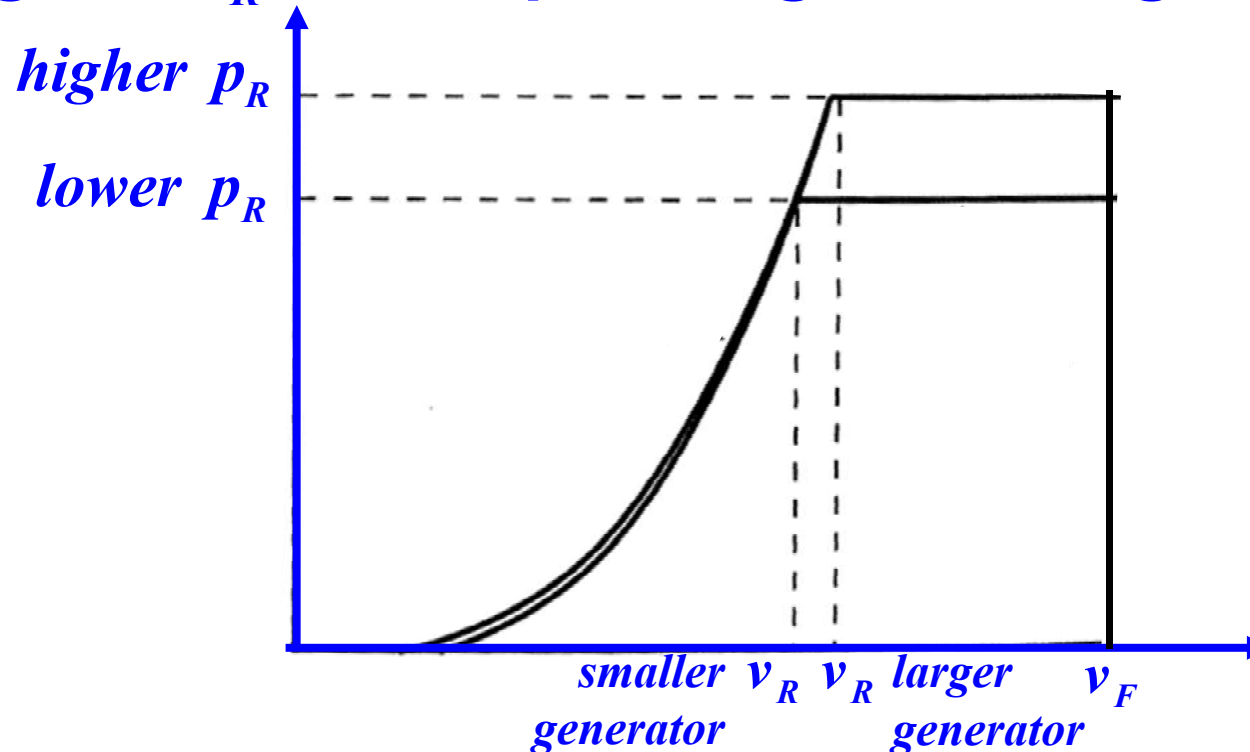

# IMPACTS OF DESIGN PARAMETERS

- ❑ Actual power curves do not veer too far from the idealized ones with much of the variance due to the *inability of wind shedding techniques to control the power outputs at speeds  $v > v_R$*  ; in certain cases, the value of  $v_R$  is difficult to determine

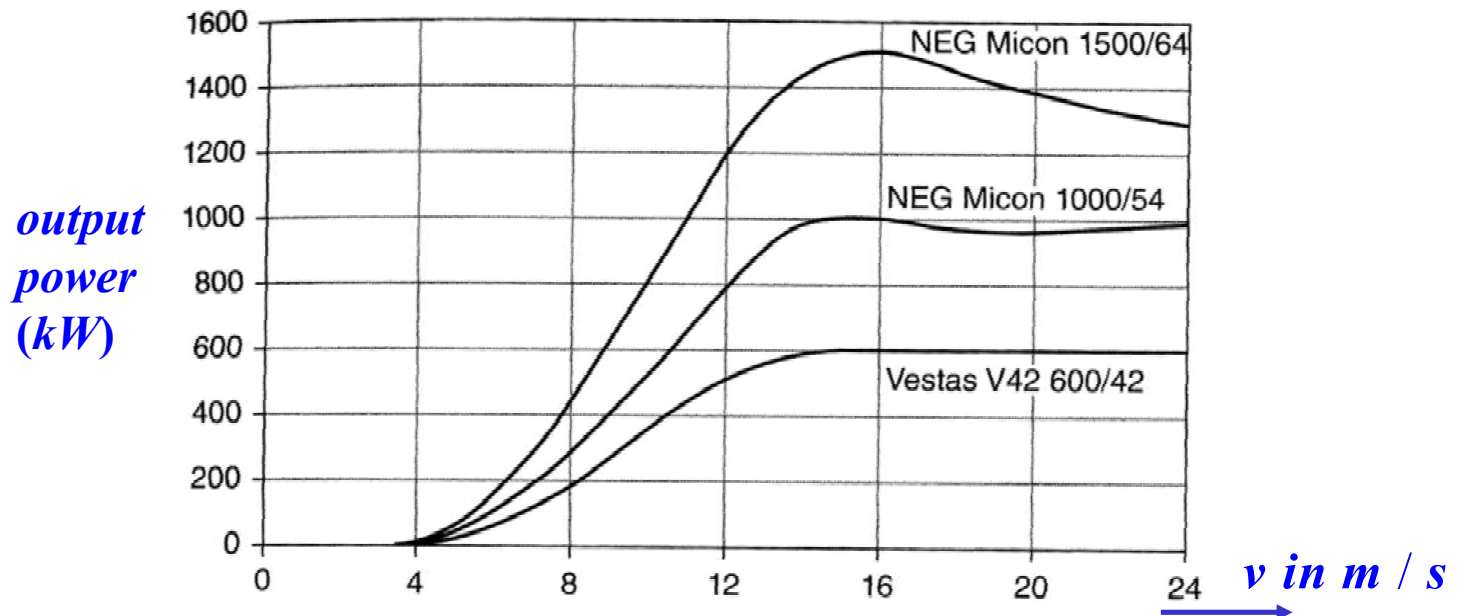


*classes of wind power density at 10 m and 50 m*

	<b>10 m (33 ft)</b>		<b>50 m (164 ft)</b>	
<i>wind power class</i>	<i>wind power density (W/m<sup>2</sup>)</i>	<i>speed m/s (mph)</i>	<i>wind power density (W/m<sup>2</sup>)</i>	<i>speed m/s (mph)</i>
<b>1</b>	<b>&lt; 100</b>	<b>&lt; 4.4 (9.8)</b>	<b>&lt; 200</b>	<b>&lt; 5.6 (12.5)</b>
<b>2</b>	<b>100 - 150</b>	<b>4.4 (9.8)/5.1 (11.5)</b>	<b>200 - 300</b>	<b>5.6 (12.5)/6.4 (14.3)</b>
<b>3</b>	<b>150 - 200</b>	<b>5.1 (11.5)/5.6 (12.5)</b>	<b>300 - 400</b>	<b>6.4 (14.3)/7.0 (15.7)</b>
<b>4</b>	<b>200 - 250</b>	<b>5.6 (12.5)/6.0 (13.4)</b>	<b>400 - 500</b>	<b>7.0 (15.7)/7.5 (16.8)</b>
<b>5</b>	<b>250 - 300</b>	<b>6.0 (13.4)/6.4 (14.3)</b>	<b>500 - 600</b>	<b>7.5 (16.8)/8.0 (17.9)</b>
<b>6</b>	<b>300 - 400</b>	<b>6.4 (14.3)/7.0 (15.7)</b>	<b>600 - 800</b>	<b>8.0 (17.9)/8.8 (19.7)</b>
<b>7</b>	<b>&gt; 400</b>	<b>&gt; 7.0 (15.7)</b>	<b>&gt; 800</b>	<b>&gt; 8.8 (19.7)</b>

Source: <http://www.awea.org/faq/basicwr.html>


# WIND POWER EQUI – DENSITY CONTOURS AT 50 m

Source: [http://www.windpoweringamerica.gov/pdfs/wind\\_maps/us\\_windmap.pdf](http://www.windpoweringamerica.gov/pdfs/wind_maps/us_windmap.pdf)

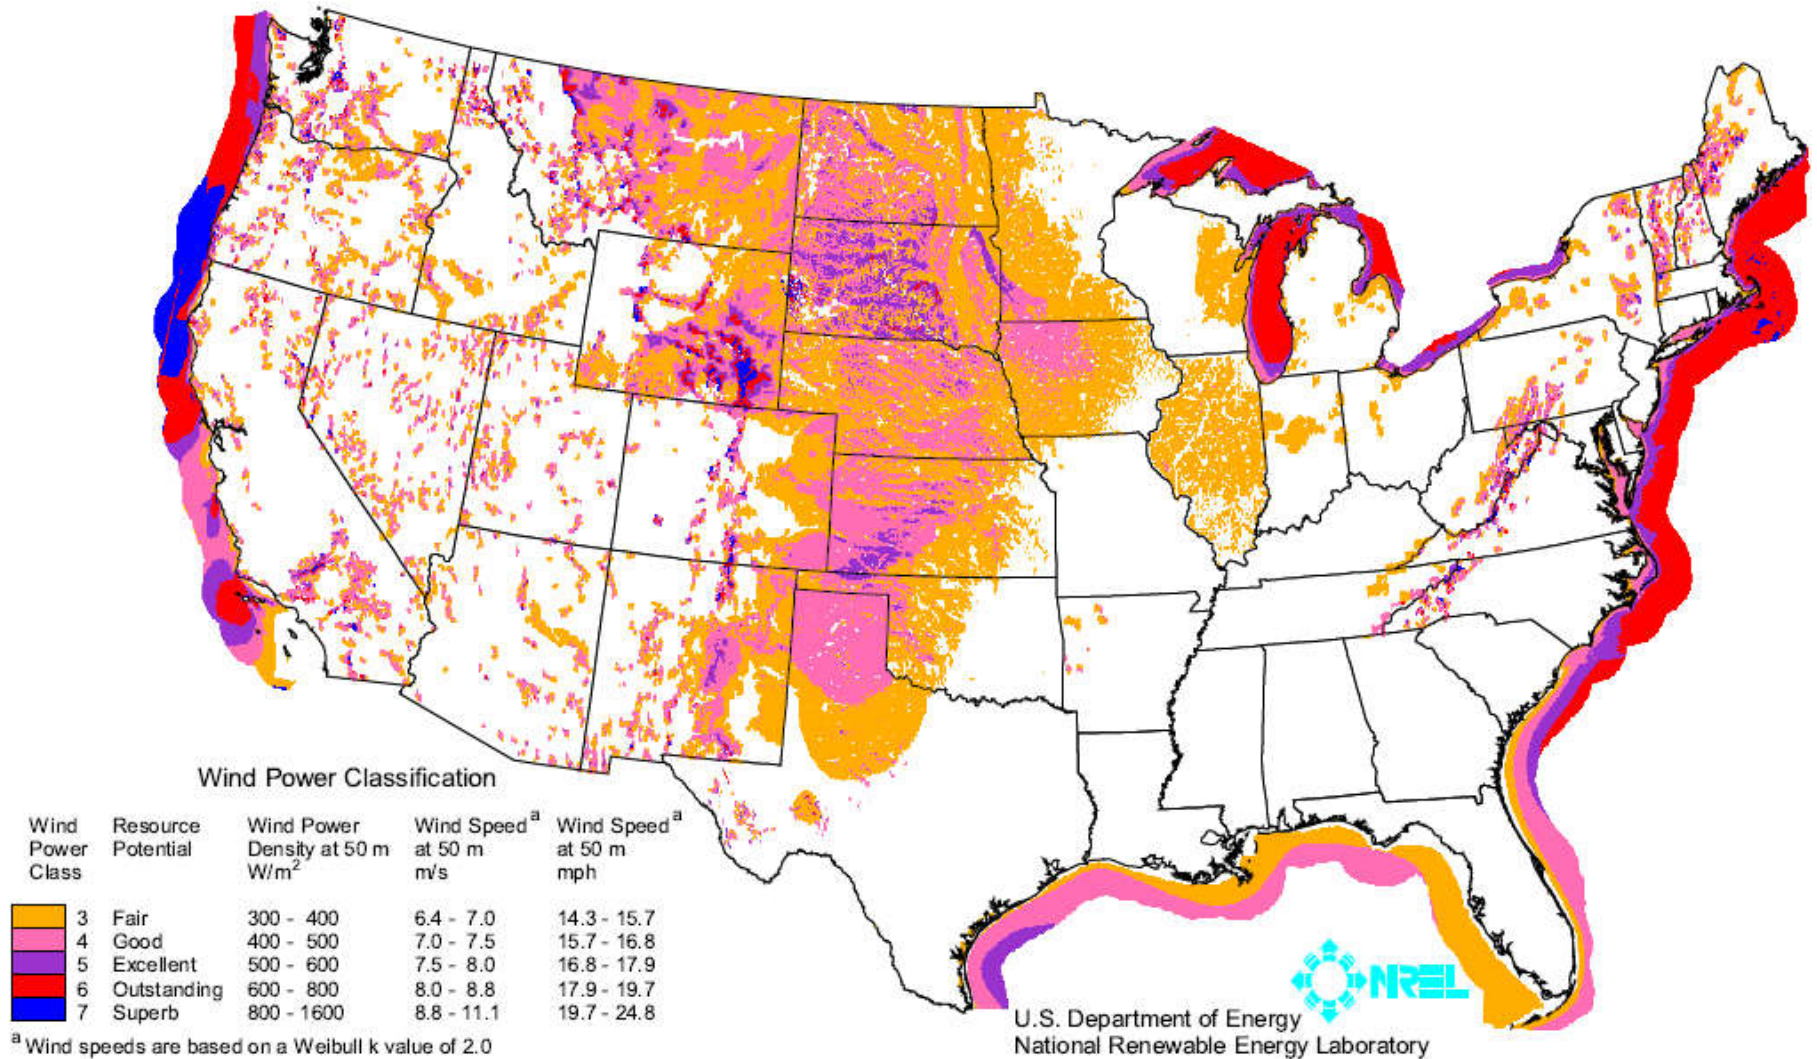


# ESTIMATES OF WIND TURBINE ENERGY

- ❑ It is not possible to extract 100 % of the power in the wind as the rotor spills high-speed winds and the little energy at low-speed winds is lost
- ❑ The energy generated depends on rotor, gearbox, generator, tower, controls, terrain, and the wind

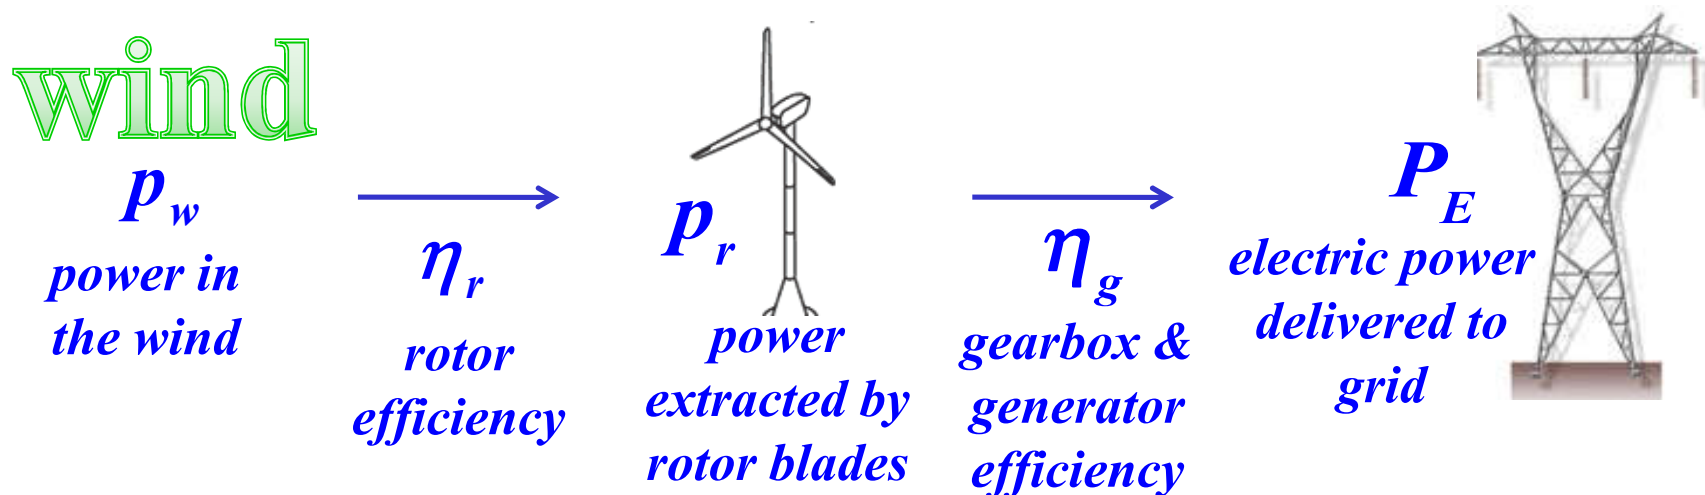



- ❑ Overall conversion efficiency  $\eta_r \eta_g$  is around 30 %

# VESTAS V52 850 kW WIND TURBINE COMPONENTS

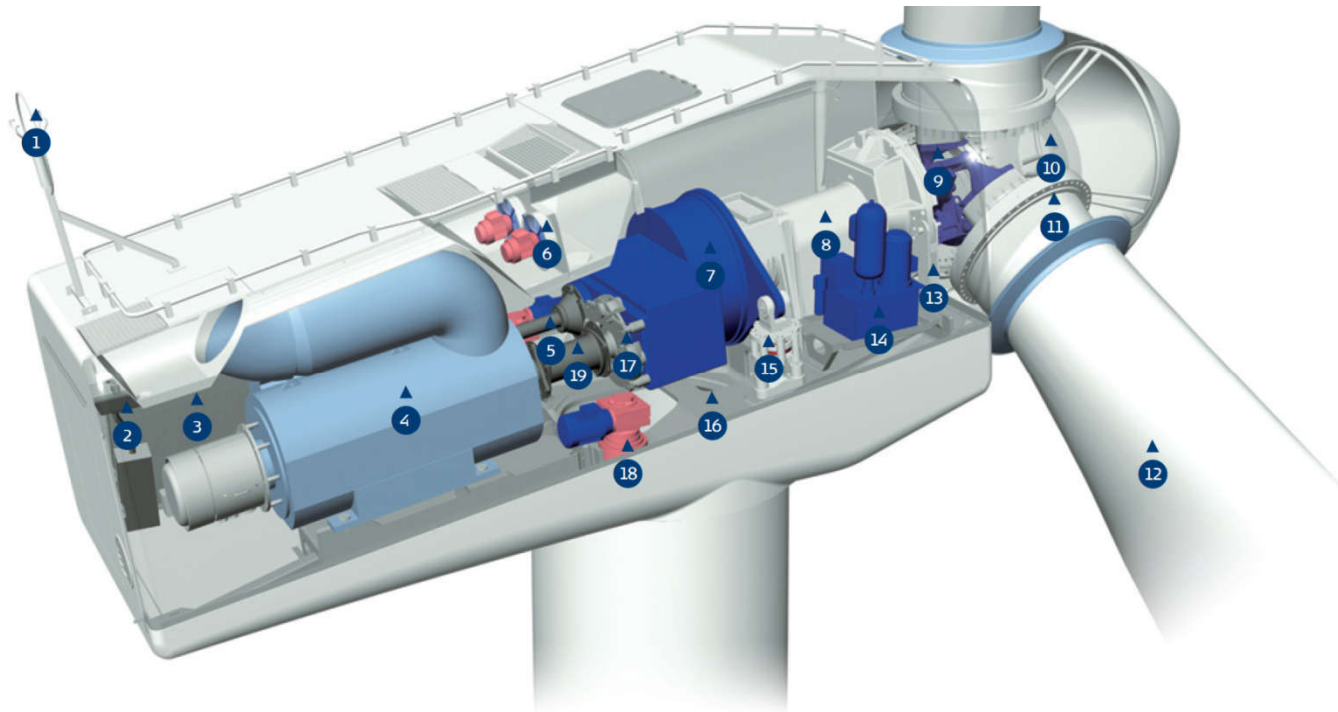


- |                                     |                         |                      |                            |
|-------------------------------------|-------------------------|----------------------|----------------------------|
| 1 Ultrasonic wind sensor            | 6 Oil and water coolers | 11 Blade bearing     | 16 Machine foundation      |
| 2 Service crane                     | 7 Gearbox               | 12 Blade             | 17 Mechanical disc brake   |
| 3 VMP-Top controller with converter | 8 Main shaft            | 13 Rotor lock system | 18 Yaw gear                |
| 4 OptiSpeed® Generator              | 9 Pitch system          | 14 Hydraulic unit    | 19 Composite disc coupling |
| 5 Pitch cylinder                    | 10 Blade hub            | 15 Torque arm        |                            |

# MANUFACTURER POWER CURVES

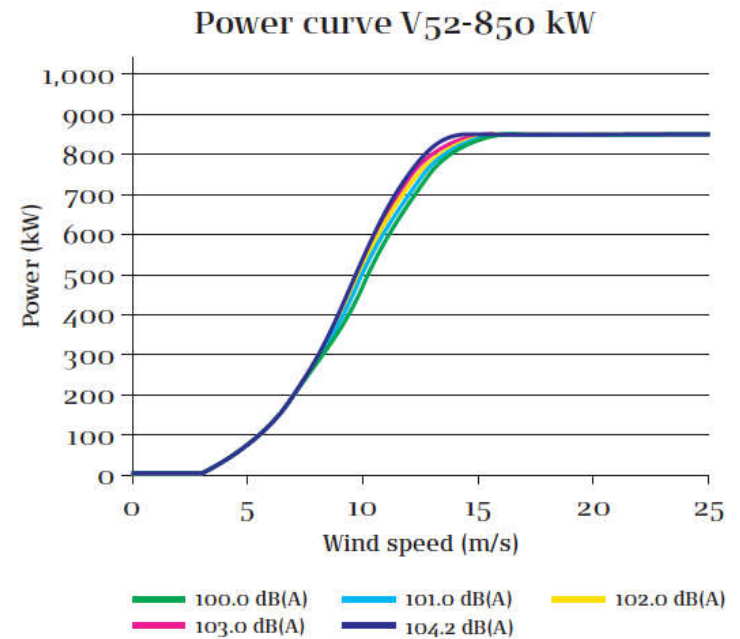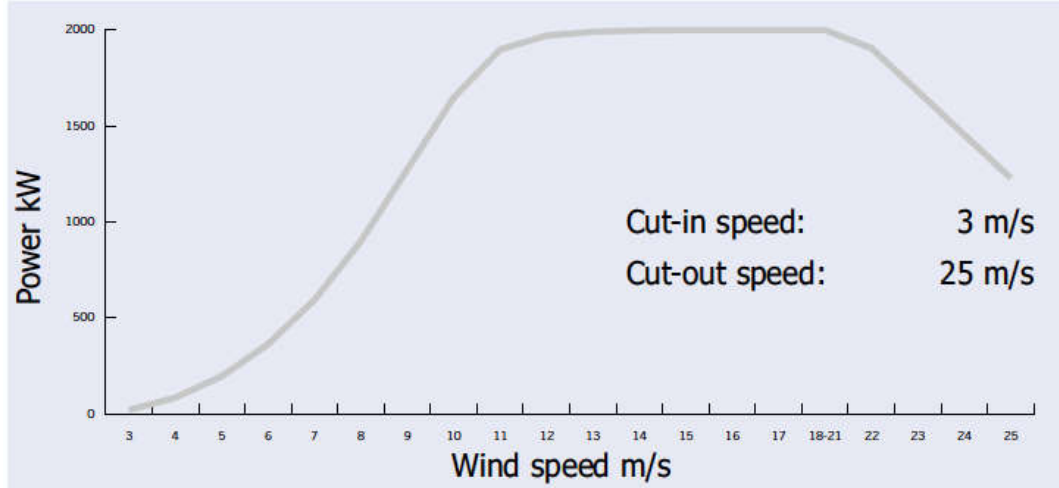

## *Gamesa G90-2.0 MW*

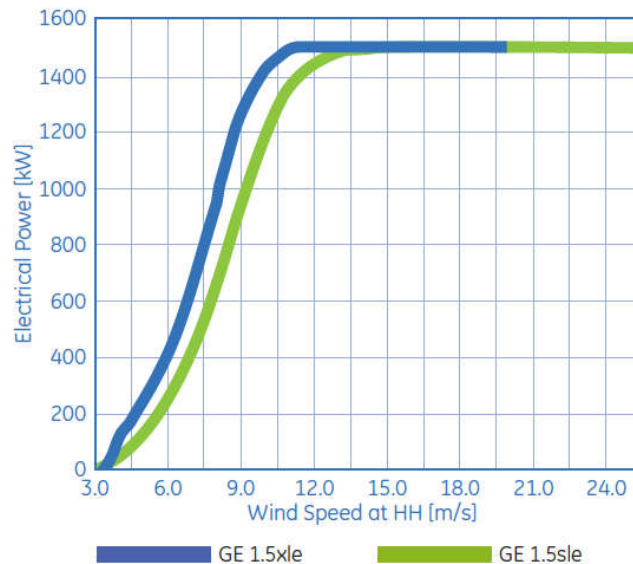

## *GE 1.5sle/xle-1.5 MW*

## *Vestas V52-850 kW*